SIEMENS

Data sheet

3UG5618-2CR20



digitally adjustable monitoring relay phase failure, phase sequence, asymmetry, frequency, over- and under-voltage monitoring with phase sequence correction 3x 90-690 V AC, 15-70 Hz 2 changeover contacts spring-loaded terminal

product brand name	SIRIUS	
product designation	Network monitoring relay with digital setting	
design of the product	automatic correction of the direction of rotation in case of wrong phase sequence, phase failure, with/without N conductor failure, asymmetry, frequency, overvoltage/undervoltage	
product type designation	3UG5	
General technical data		
product function	line monitoring	
display version LED	No	
design of the display	LCD	
power loss [W] maximum	2 W	
power loss [V·A] maximum	5.1 VA	
insulation voltage for overvoltage category III according to IEC 60664		
 with degree of pollution 2 rated value 	690 V	
 with degree of pollution 3 rated value 	690 V	
degree of pollution	3	
type of voltage		
for monitoring	AC	
 of the operating voltage for actuation 	AC/DC	
 of the control supply voltage 	AC	
surge voltage resistance rated value	6 kV	
protection class IP	IP20	
shock resistance according to IEC 60068-2-27	sinusoidal half-wave 15g / 11 ms	
switching behavior	monostable	
mechanical service life (operating cycles) typical	10 000 000	
electrical endurance (operating cycles) at AC-15 at 230 V typical	100 000	
thermal current of the switching element with contacts maximum	5 A	
adjustable OFF-delay time	0.1 30 s	
reference code according to IEC 81346-2	К	
relative repeat accuracy	0.4 %	
Substance Prohibitance (Date)	06/01/2023	
SVHC substance name	Blei - 7439-92-1 Bleimonoxid (Bleioxid) - 1317-36-8	
Product Function		
product function		
 undervoltage detection 	Yes	
 overvoltage detection 	Yes	
 phase sequence recognition 	Yes	
phase failure detection	Yes; available but limited, detection is problematic with high levels of	

	regenerative power recovery
 asymmetry detection 	Yes
overvoltage detection 3 phase	Yes
undervoltage detection 3 phases	Yes
voltage window recognition 3 phase	Yes
 adjustable open/closed-circuit current principle auto-RESET 	Yes
	Yes
suitability for use safety-related circuits Control circuit/ Control	No
control supply voltage at AC	00 600 \/
 at 50 Hz rated value at 60 Hz rated value 	90 690 V 90 690 V
operating range factor control supply voltage rated value at AC at 50 Hz	30 090 V
• initial value	0.85
• full-scale value	1.1
operating range factor control supply voltage rated value at AC at 60 Hz	
• initial value	0.85
• full-scale value	1.1
Supply voltage	
supply voltage frequency rated value	70 15 Hz
Measuring circuit	
measurable voltage at AC	90 690 V
adjustable operating delay time	0 s
adjustable response delay time	
when starting	0.1 30 s
 with lower or upper limit violation 	0.1 30 s
buffering time in the event of power failure minimum	20 ms
response time maximum	500 ms
accuracy of digital display	+/-1 digit
relative temperature-related measurement deviation	1 %
Precision	
relative metering precision	3 %
	3 % 0.001 %/°C
relative metering precision	
relative metering precision temperature drift per °C	
relative metering precision temperature drift per °C Short-circuit protection	
relative metering precision temperature drift per °C Short-circuit protection design of the fuse link • for short-circuit protection of the NO contacts of the relay outputs required • for short circuit protection of the NC contacts of the relay outputs required • for short circuit protection of the NC contacts of the relay outputs required	0.001 %/°C
relative metering precision temperature drift per °C Short-circuit protection design of the fuse link • for short-circuit protection of the NO contacts of the relay outputs required • for short circuit protection of the NC contacts of the relay outputs required • for short circuit protection of the NC contacts of the relay outputs required Communication/ Protocol	0.001 %/°C gL/gG: 6 A or MCB type C: 1 A gL/gG: 6 A or MCB type C: 1 A
relative metering precision temperature drift per °C Short-circuit protection design of the fuse link • for short-circuit protection of the NO contacts of the relay outputs required • for short circuit protection of the NC contacts of the relay outputs required • for short circuit protection of the NC contacts of the relay outputs required Communication/ Protocol protocol is supported IO-Link protocol	0.001 %/°C gL/gG: 6 A or MCB type C: 1 A gL/gG: 6 A or MCB type C: 1 A
relative metering precision temperature drift per °C Short-circuit protection design of the fuse link • for short-circuit protection of the NO contacts of the relay outputs required • for short circuit protection of the NC contacts of the relay outputs required • for short circuit protection of the NC contacts of the relay outputs required Communication/ Protocol protocol is supported IO-Link protocol type of voltage supply via input/output link master	0.001 %/°C gL/gG: 6 A or MCB type C: 1 A gL/gG: 6 A or MCB type C: 1 A
relative metering precision temperature drift per °C Short-circuit protection design of the fuse link • for short-circuit protection of the NO contacts of the relay outputs required • for short circuit protection of the NC contacts of the relay outputs required • for short circuit protection of the NC contacts of the relay outputs required Communication/ Protocol protocol is supported IO-Link protocol type of voltage supply via input/output link master Auxiliary circuit	0.001 %/°C gL/gG: 6 A or MCB type C: 1 A gL/gG: 6 A or MCB type C: 1 A No No
relative metering precision temperature drift per °C Short-circuit protection design of the fuse link • for short-circuit protection of the NO contacts of the relay outputs required • for short circuit protection of the NC contacts of the relay outputs required • for short circuit protection of the NC contacts of the relay outputs required Communication/ Protocol protocol is supported IO-Link protocol type of voltage supply via input/output link master Auxiliary circuit material of switching contacts	0.001 %/°C gL/gG: 6 A or MCB type C: 1 A gL/gG: 6 A or MCB type C: 1 A No No Ag\$nO2
relative metering precision temperature drift per °C Short-circuit protection design of the fuse link • for short-circuit protection of the NO contacts of the relay outputs required • for short circuit protection of the NC contacts of the relay outputs required • for short circuit protection of the NC contacts of the relay outputs required Communication/ Protocol protocol is supported IO-Link protocol type of voltage supply via input/output link master Auxiliary circuit material of switching contacts number of NC contacts delayed switching	0.001 %/°C gL/gG: 6 A or MCB type C: 1 A gL/gG: 6 A or MCB type C: 1 A No No AgSnO2 0
relative metering precision temperature drift per °C Short-circuit protection design of the fuse link • for short-circuit protection of the NO contacts of the relay outputs required • for short circuit protection of the NC contacts of the relay outputs required Communication/ Protocol protocol is supported IO-Link protocol type of voltage supply via input/output link master Auxiliary circuit material of switching contacts number of NC contacts delayed switching number of NO contacts delayed switching	0.001 %/°C gL/gG: 6 A or MCB type C: 1 A gL/gG: 6 A or MCB type C: 1 A No No Ag\$nO2
relative metering precision temperature drift per °C Short-circuit protection design of the fuse link • for short-circuit protection of the NO contacts of the relay outputs required • for short circuit protection of the NC contacts of the relay outputs required • for short circuit protection of the NC contacts of the relay outputs required Communication/ Protocol protocol is supported IO-Link protocol type of voltage supply via input/output link master Auxiliary circuit material of switching contacts number of NC contacts delayed switching number of CO contacts	0.001 %/°C gL/gG: 6 A or MCB type C: 1 A gL/gG: 6 A or MCB type C: 1 A No No AgSnO2 0 0
relative metering precision temperature drift per °C Short-circuit protection design of the fuse link • for short-circuit protection of the NO contacts of the relay outputs required • for short circuit protection of the NC contacts of the relay outputs required Ommunication/ Protocol protocol is supported IO-Link protocol type of voltage supply via input/output link master Auxiliary circuit material of switching contacts number of NC contacts delayed switching number of CO contacts • for auxiliary contacts	0.001 %/°C gL/gG: 6 A or MCB type C: 1 A gL/gG: 6 A or MCB type C: 1 A No No AgSnO2 0 0 2
relative metering precision temperature drift per °C Short-circuit protection design of the fuse link • for short-circuit protection of the NO contacts of the relay outputs required • for short circuit protection of the NC contacts of the relay outputs required • for short circuit protection of the NC contacts of the relay outputs required Communication/ Protocol protocol is supported IO-Link protocol type of voltage supply via input/output link master Auxiliary circuit material of switching contacts number of NC contacts delayed switching number of CO contacts • for auxiliary contacts • delayed switching	0.001 %/°C gL/gG: 6 A or MCB type C: 1 A gL/gG: 6 A or MCB type C: 1 A No No AgSnO2 0 0 2 2
relative metering precision temperature drift per °C Short-circuit protection design of the fuse link • for short-circuit protection of the NO contacts of the relay outputs required • for short circuit protection of the NC contacts of the relay outputs required • for short circuit protection of the NC contacts of the relay outputs required Communication/ Protocol protocol is supported IO-Link protocol type of voltage supply via input/output link master Auxiliary circuit material of switching contacts number of NC contacts delayed switching number of CO contacts • for auxiliary contacts • for auxiliary contacts • delayed switching operating frequency with 3RT2 contactor maximum	0.001 %/°C gL/gG: 6 A or MCB type C: 1 A gL/gG: 6 A or MCB type C: 1 A No No AgSnO2 0 0 2 2 2 5 000 1/h
relative metering precision temperature drift per °C Short-circuit protection design of the fuse link • for short-circuit protection of the NO contacts of the relay outputs required • for short circuit protection of the NC contacts of the relay outputs required • for short circuit protection of the NC contacts of the relay outputs required Communication/ Protocol protocol is supported IO-Link protocol type of voltage supply via input/output link master Auxiliary circuit material of switching contacts number of NC contacts delayed switching number of CO contacts • for auxiliary contacts • delayed switching operating frequency with 3RT2 contactor maximum contact reliability of auxiliary contacts	0.001 %/°C gL/gG: 6 A or MCB type C: 1 A gL/gG: 6 A or MCB type C: 1 A No No AgSnO2 0 0 2 2 2 5 000 1/h one incorrect switching operation of 100 million switching operations (17 V, 5 mA)
relative metering precision temperature drift per °C Short-circuit protection design of the fuse link • for short-circuit protection of the NO contacts of the relay outputs required • for short circuit protection of the NC contacts of the relay outputs required Communication/ Protocol protocol is supported IO-Link protocol type of voltage supply via input/output link master Auxiliary circuit material of switching contacts number of NC contacts delayed switching number of CO contacts • for auxiliary contacts • delayed switching operating frequency with 3RT2 contactor maximum contact reliability of auxiliary contacts contact rating of auxiliary contacts according to UL	0.001 %/°C gL/gG: 6 A or MCB type C: 1 A gL/gG: 6 A or MCB type C: 1 A No No AgSnO2 0 0 2 2 2 5 000 1/h one incorrect switching operation of 100 million switching operations (17 V, 5
relative metering precision temperature drift per °C Short-circuit protection design of the fuse link • for short-circuit protection of the NO contacts of the relay outputs required • for short circuit protection of the NC contacts of the relay outputs required Communication/ Protocol protocol is supported IO-Link protocol type of voltage supply via input/output link master Auxiliary circuit material of switching contacts number of NC contacts delayed switching number of CO contacts • for auxiliary contacts • delayed switching operating frequency with 3RT2 contactor maximum contact reliability of auxiliary contacts contact rating of auxiliary contacts according to UL	0.001 %/°C gL/gG: 6 A or MCB type C: 1 A gL/gG: 6 A or MCB type C: 1 A No No AgSnO2 0 0 2 2 2 5 000 1/h one incorrect switching operation of 100 million switching operations (17 V, 5 mA) R300 / B300
relative metering precision temperature drift per °C Short-circuit protection design of the fuse link • for short-circuit protection of the NO contacts of the relay outputs required • for short circuit protection of the NC contacts of the relay outputs required Communication/ Protocol protocol is supported IO-Link protocol type of voltage supply via input/output link master Auxiliary circuit material of switching contacts number of NC contacts delayed switching number of CO contacts • for auxiliary contacts • delayed switching operating frequency with 3RT2 contactor maximum contact reliability of auxiliary contacts contact rating of auxiliary contacts according to UL Main circuit number of poles for main current circuit	0.001 %/°C gL/gG: 6 A or MCB type C: 1 A gL/gG: 6 A or MCB type C: 1 A No No AgSnO2 0 0 2 2 2 5 000 1/h one incorrect switching operation of 100 million switching operations (17 V, 5 mA)
relative metering precision temperature drift per °C Short-circuit protection design of the fuse link • for short-circuit protection of the NO contacts of the relay outputs required • for short circuit protection of the NC contacts of the relay outputs required Communication/ Protocol protocol is supported IO-Link protocol type of voltage supply via input/output link master Auxiliary circuit material of switching contacts number of NC contacts delayed switching number of CO contacts • for auxiliary contacts • delayed switching operating frequency with 3RT2 contactor maximum contact rating of auxiliary contacts contact rating of auxiliary contacts according to UL Main circuit number of poles for main current circuit ampacity of the output relay at AC-15	0.001 %/°C gL/gG: 6 A or MCB type C: 1 A gL/gG: 6 A or MCB type C: 1 A No No AgSnO2 0 0 2 2 2 5 000 1/h one incorrect switching operation of 100 million switching operations (17 V, 5 mA) R300 / B300 4
relative metering precision temperature drift per °C Short-circuit protection design of the fuse link • for short-circuit protection of the NO contacts of the relay outputs required • for short circuit protection of the NC contacts of the relay outputs required Communication/ Protocol protocol is supported IO-Link protocol type of voltage supply via input/output link master Auxiliary circuit material of switching contacts number of NC contacts delayed switching number of CO contacts • for auxiliary contacts • delayed switching operating frequency with 3RT2 contactor maximum contact reliability of auxiliary contacts contact rating of auxiliary contacts according to UL Main circuit number of poles for main current circuit ampacity of the output relay at AC-15 • at 250 V at 50/60 Hz	0.001 %/°C gL/gG: 6 A or MCB type C: 1 A gL/gG: 6 A or MCB type C: 1 A No No AgSnO2 0 0 2 2 2 5 000 1/h one incorrect switching operation of 100 million switching operations (17 V, 5 mA) R300 / B300
relative metering precision temperature drift per °C Short-circuit protection design of the fuse link • for short-circuit protection of the NO contacts of the relay outputs required • for short circuit protection of the NC contacts of the relay outputs required • for short circuit protection of the NC contacts of the relay outputs required Communication/ Protocol protocol is supported IO-Link protocol type of voltage supply via input/output link master Auxiliary circuit material of switching contacts number of NC contacts delayed switching number of CO contacts • for auxiliary contacts • delayed switching operating frequency with 3RT2 contactor maximum contact reliability of auxiliary contacts contact reliability of auxiliary contacts contact rating of auxiliary contacts according to UL Main circuit number of poles for main current circuit ampacity of the output relay at AC-15 • at 250 V at 50/60 Hz ampacity of the output relay at DC-13	0.001 %/°C gL/gG: 6 A or MCB type C: 1 A gL/gG: 6 A or MCB type C: 1 A No No AgSnO2 0 0 2 2 2 5 000 1/h one incorrect switching operation of 100 million switching operations (17 V, 5 mA) R300 / B300 4 3 A
relative metering precision temperature drift per °C Short-circuit protection design of the fuse link • for short-circuit protection of the NO contacts of the relay outputs required • for short circuit protection of the NC contacts of the relay outputs required Communication/ Protocol protocol is supported IO-Link protocol type of voltage supply via input/output link master Auxiliary circuit material of switching contacts number of NC contacts delayed switching number of CO contacts • for auxiliary contacts • delayed switching operating frequency with 3RT2 contactor maximum contact reliability of auxiliary contacts contact rating of auxiliary contacts according to UL Main circuit number of poles for main current circuit ampacity of the output relay at AC-15 • at 250 V at 50/60 Hz	0.001 %/°C gL/gG: 6 A or MCB type C: 1 A gL/gG: 6 A or MCB type C: 1 A No No AgSnO2 0 0 2 2 2 5 000 1/h one incorrect switching operation of 100 million switching operations (17 V, 5 mA) R300 / B300 4

• at 125 V	0.2 A
• at 230 V	0.1 A
• at 250 V	0.1 A
operational current at 17 V minimum	5 mA
continuous current of the DIAZED fuse link of the output relay	6 A
Electromagnetic compatibility	
EMC emitted interference according to IEC 60947-1	class A
conducted interference	
 due to burst according to IEC 61000-4-4 	2 kV (power ports), 2 kV (signal ports)
 due to conductor-earth surge according to IEC 61000-4-5 	2 kV
 due to conductor-conductor surge according to IEC 61000-4-5 	1 KV
field-based interference according to IEC 61000-4-3	10 V/m
electrostatic discharge according to IEC 61000-4-2	6 kV contact discharge / 8 kV air discharge
Galvanic isolation	
design of the electrical isolation	galvanic isolation
galvanic isolation	
 between input and output 	Yes
between the outputs	Yes
 between the voltage supply and other circuits 	Yes
Connections/ Terminals	
product component removable terminal for main circuit	Yes
product component removable terminal for auxiliary and control circuit	Yes
type of electrical connection	spring-loaded terminals
type of connectable conductor cross-sections	
solid	0.5 4 mm²
 finely stranded with core end processing 	0.5 2.5 mm ²
 finely stranded without core end processing 	0.5 4 mm²
 for AWG cables solid 	20 12
 for AWG cables stranded 	20 12
connectable conductor cross-section	
• solid	0.5 4 mm²
 finely stranded with core end processing 	0.5 2.5 mm²
 finely stranded without core end processing 	0.25 1.5 mm²
AWG number as coded connectable conductor cross section	
• solid	24 12
stranded	20 12
stripped length	10 mm
Installation/ mounting/ dimensions	
mounting position	any
fastening method	screw and snap-on mounting onto 35 mm DIN rail
height	100 mm
width	22.5 mm
depth	90 mm
required spacing	
with side-by-side mounting	
— forwards	0 mm
— backwards	0 mm
— upwards	0 mm
— downwards	0 mm
— at the side	0 mm
 for grounded parts 	
— forwards	0 mm
— backwards	0 mm
— upwards	0 mm
— at the side	0 mm
— downwards	0 mm
for live parts	
— forwards	0 mm
- 101Walus	VIIIII

— backwards	0 mm	
— upwards	0 mm	
- downwards	0 mm	
— at the side	0 mm	
Ambient conditions		
installation altitude at height above sea level maximum	2 000 m	
ambient temperature		
 during operation 	-25 +60 °C	
 during storage 	-40 +85 °C	
during transport	-40 +85 °C	
relative humidity during operation	70 %	
Approvals Certificates		
General Product Approval	Те	est Certificates
- CO `		<u>ype Test Certific-</u> ates/Test Report

other

Confirmation

Further information

Siemens has decided to exit the Russian market (see here).

https://press.siemens.com/global/en/pressrelease/siemens-wind-down-russian-business

Siemens is working on the renewal of the current EAC certificates.

Please contact your local Siemens office on the status of validity of the EAC certification if you intend to import or offer to supply these products to an EAC relevant market (other than the sanctioned EAEU member states Russia or Belarus).

Information on the packaging

https://support.industry.siemens.com/cs/ww/en/view/109813875

Information- and Downloadcenter (Catalogs, Brochures,...)

https://www.siemens.com/ic10

Industry Mall (Online ordering system)

https://mall.industry.siemens.com/mall/en/en/Catalog/product?mlfb=3UG5618-2CR20

Cax online generator

http://support.automation.siemens.com/WW/CAXorder/default.aspx?lang=en&mlfb=3UG5618-2CR20

Service&Support (Manuals, Certificates, Characteristics, FAQs,...)


https://support.industry.siemens.com/cs/ww/en/ps/3UG5618-2CR20


Image database (product images, 2D dimension drawings, 3D models, device circuit diagrams, EPLAN macros, ...)


http://www.automation.siemens.com/bilddb/cax_de.aspx?mlfb=3UG5618-2CR20&lang=en


Characteristic: Derating


https://support.industry.siemens.com/cs/ww/en/ps/3UG5618-2CR20/manual

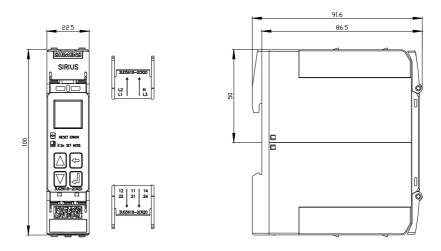

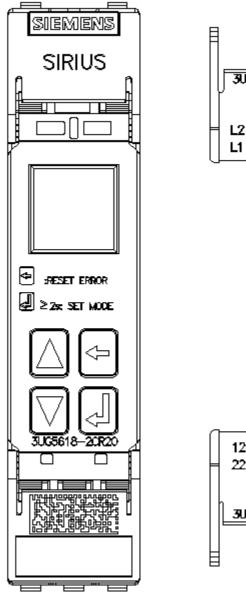





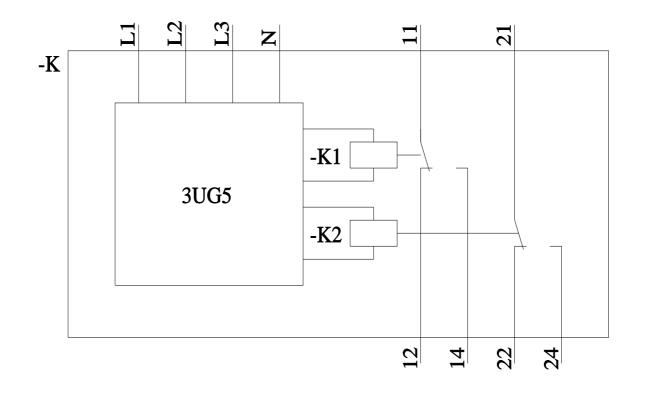

last modified:

12/13/2023 🖸