# SIEMENS

### Data sheet

## 3UG5511-2BR20



monitoring relay phase sequence monitoring 3x 160-690 V AC, 15-70 Hz 2 changeover contacts spring-loaded terminal

product brand name	SIRIUS
product designation	Line monitoring relay
design of the product	monitoring of phase sequence
product type designation	3UG5
General technical data	
product function	line monitoring
display version LED	Yes
design of the display	LED
power loss [W] maximum	1.8 W
power loss [V·A] maximum	5.1 VA
insulation voltage for overvoltage category III according to IEC 60664	
<ul> <li>with degree of pollution 2 rated value</li> </ul>	690 V
<ul> <li>with degree of pollution 3 rated value</li> </ul>	690 V
degree of pollution	3
type of voltage	
<ul> <li>for monitoring</li> </ul>	AC
<ul> <li>of the operating voltage for actuation</li> </ul>	AC/DC
<ul> <li>of the control supply voltage</li> </ul>	AC
surge voltage resistance rated value	6 kV
protection class IP	IP20
shock resistance according to IEC 60068-2-27	sinusoidal half-wave 15g / 11 ms
switching behavior	monostable
mechanical service life (operating cycles) typical	10 000 000
electrical endurance (operating cycles) at AC-15 at 230 V typical	100 000
thermal current of the switching element with contacts maximum	5 A
reference code according to IEC 81346-2	К
Substance Prohibitance (Date)	06/01/2023
SVHC substance name	Blei - 7439-92-1 Bleimonoxid (Bleioxid) - 1317-36-8
Product Function	
product function	
<ul> <li>undervoltage detection</li> </ul>	No
overvoltage detection	No
<ul> <li>phase sequence recognition</li> </ul>	Yes
phase failure detection	Yes; available but limited, detection is problematic with high levels of regenerative power recovery
<ul> <li>asymmetry detection</li> </ul>	No; not adjustable, indirectly by monitoring the voltage limit values
<ul> <li>overvoltage detection 3 phase</li> </ul>	No
<ul> <li>undervoltage detection 3 phases</li> </ul>	No

• voltage window recognition 2 phase	No
<ul> <li>voltage window recognition 3 phase</li> <li>adjustable open/closed-circuit current principle</li> </ul>	No
auto-RESET	Yes
suitability for use safety-related circuits	No
Control circuit/ Control	INU
control supply voltage at AC	
at 50 Hz rated value	90 690 V
at 60 Hz rated value	90 690 V
operating range factor control supply voltage rated value at AC at 50 Hz	
• initial value	0.85
• full-scale value	1.1
operating range factor control supply voltage rated value at AC at 60 Hz	
• initial value	0.85
• full-scale value	1.1
Supply voltage	
supply voltage frequency rated value	70 15 Hz
Measuring circuit	
measurable voltage at AC	90 690 V
buffering time in the event of power failure minimum	20 ms
response time maximum	500 ms
Short-circuit protection	
<ul> <li>design of the fuse link</li> <li>for short-circuit protection of the NO contacts of the relay outputs required</li> </ul>	gL/gG: 6 A or MCB type C: 1 A
<ul> <li>for short circuit protection of the NC contacts of the relay outputs required</li> </ul>	gL/gG: 6 A or MCB type C: 1 A
Communication/ Protocol	
protocol is supported IO-Link protocol	No
type of voltage supply via input/output link master	No
Auxiliary circuit	
material of switching contacts	AgSnO2
number of NC contacts delayed switching	0
	0 0
number of NC contacts delayed switching	
number of NC contacts delayed switching number of NO contacts delayed switching	
number of NC contacts delayed switching number of NO contacts delayed switching number of CO contacts	0
number of NC contacts delayed switching number of NO contacts delayed switching number of CO contacts • for auxiliary contacts	0 2
number of NC contacts delayed switching number of NO contacts delayed switching number of CO contacts • for auxiliary contacts • delayed switching operating frequency with 3RT2 contactor maximum contact reliability of auxiliary contacts	0 2 0 5 000 1/h one incorrect switching operation of 100 million switching operations (17 V, 5 mA)
number of NC contacts delayed switching number of NO contacts delayed switching number of CO contacts • for auxiliary contacts • delayed switching operating frequency with 3RT2 contactor maximum contact reliability of auxiliary contacts contact rating of auxiliary contacts according to UL	0 2 0 5 000 1/h one incorrect switching operation of 100 million switching operations (17 V, 5
number of NC contacts delayed switching number of NO contacts delayed switching number of CO contacts • for auxiliary contacts • delayed switching operating frequency with 3RT2 contactor maximum contact reliability of auxiliary contacts contact rating of auxiliary contacts according to UL Main circuit	0 2 0 5 000 1/h one incorrect switching operation of 100 million switching operations (17 V, 5 mA) R300 / B300
number of NC contacts delayed switching number of NO contacts delayed switching number of CO contacts • for auxiliary contacts • delayed switching operating frequency with 3RT2 contactor maximum contact reliability of auxiliary contacts contact rating of auxiliary contacts according to UL Main circuit number of poles for main current circuit	0 2 0 5 000 1/h one incorrect switching operation of 100 million switching operations (17 V, 5 mA)
number of NC contacts delayed switching         number of NO contacts delayed switching         number of CO contacts         • for auxiliary contacts         • delayed switching         operating frequency with 3RT2 contactor maximum         contact reliability of auxiliary contacts         contact rating of auxiliary contacts according to UL         Main circuit         number of poles for main current circuit         ampacity of the output relay at AC-15	0 2 0 5 000 1/h one incorrect switching operation of 100 million switching operations (17 V, 5 mA) R300 / B300
number of NC contacts delayed switching number of NO contacts delayed switching number of CO contacts • for auxiliary contacts • delayed switching operating frequency with 3RT2 contactor maximum contact reliability of auxiliary contacts contact rating of auxiliary contacts according to UL Main circuit number of poles for main current circuit ampacity of the output relay at AC-15 • at 250 V at 50/60 Hz	0 2 0 5 000 1/h one incorrect switching operation of 100 million switching operations (17 V, 5 mA) R300 / B300 3 3
number of NC contacts delayed switching number of NO contacts delayed switching number of CO contacts • for auxiliary contacts • delayed switching operating frequency with 3RT2 contactor maximum contact reliability of auxiliary contacts contact rating of auxiliary contacts according to UL Main circuit number of poles for main current circuit ampacity of the output relay at AC-15 • at 250 V at 50/60 Hz • at 400 V at 50/60 Hz	0 2 0 5 000 1/h one incorrect switching operation of 100 million switching operations (17 V, 5 mA) R300 / B300
number of NC contacts delayed switching         number of NO contacts delayed switching         number of CO contacts         • for auxiliary contacts         • delayed switching         operating frequency with 3RT2 contactor maximum         contact reliability of auxiliary contacts         contact reliability of auxiliary contacts according to UL         Main circuit         number of poles for main current circuit         ampacity of the output relay at AC-15         • at 400 V at 50/60 Hz         • at 400 V at 50/60 Hz         ampacity of the output relay at DC-13	0 2 0 5 000 1/h one incorrect switching operation of 100 million switching operations (17 V, 5 mA) R300 / B300 3 3 3 A 3 A
number of NC contacts delayed switching number of NO contacts delayed switching number of CO contacts • for auxiliary contacts • delayed switching operating frequency with 3RT2 contactor maximum contact reliability of auxiliary contacts contact rating of auxiliary contacts according to UL Main circuit number of poles for main current circuit ampacity of the output relay at AC-15 • at 250 V at 50/60 Hz • at 400 V at 50/60 Hz ampacity of the output relay at DC-13 • at 24 V	0 2 0 5 000 1/h one incorrect switching operation of 100 million switching operations (17 V, 5 mA) R300 / B300 3 3 1 A
number of NC contacts delayed switching         number of NO contacts delayed switching         number of CO contacts         • for auxiliary contacts         • delayed switching         operating frequency with 3RT2 contactor maximum         contact reliability of auxiliary contacts         contact rating of auxiliary contacts according to UL         Main circuit         number of poles for main current circuit         ampacity of the output relay at AC-15         • at 250 V at 50/60 Hz         • at 400 V at 50/60 Hz         • at 224 V         • at 110 V	0 2 0 5 000 1/h one incorrect switching operation of 100 million switching operations (17 V, 5 mA) R300 / B300 3 3 1 A 0.2 A
number of NC contacts delayed switching number of NO contacts delayed switching number of CO contacts • for auxiliary contacts • delayed switching operating frequency with 3RT2 contactor maximum contact reliability of auxiliary contacts contact rating of auxiliary contacts according to UL Main circuit number of poles for main current circuit ampacity of the output relay at AC-15 • at 250 V at 50/60 Hz • at 400 V at 50/60 Hz ampacity of the output relay at DC-13 • at 24 V • at 110 V • at 125 V	0 2 0 5 000 1/h one incorrect switching operation of 100 million switching operations (17 V, 5 mA) R300 / B300 3 3 1 A 0.2 A 0.2 A
number of NC contacts delayed switching         number of NO contacts delayed switching         number of CO contacts         • for auxiliary contacts         • delayed switching         operating frequency with 3RT2 contactor maximum         contact reliability of auxiliary contacts         contact rating of auxiliary contacts according to UL         Main circuit         number of poles for main current circuit         ampacity of the output relay at AC-15         • at 250 V at 50/60 Hz         • at 400 V at 50/60 Hz         • at 224 V         • at 110 V	0 2 0 5 000 1/h one incorrect switching operation of 100 million switching operations (17 V, 5 mA) R300 / B300 3 3 1 A 0.2 A
number of NC contacts delayed switching number of NO contacts delayed switching number of CO contacts • for auxiliary contacts • delayed switching operating frequency with 3RT2 contactor maximum contact reliability of auxiliary contacts contact reliability of auxiliary contacts according to UL Main circuit number of poles for main current circuit ampacity of the output relay at AC-15 • at 250 V at 50/60 Hz • at 400 V at 50/60 Hz • at 24 V • at 110 V • at 125 V • at 230 V	0 2 0 5 000 1/h one incorrect switching operation of 100 million switching operations (17 V, 5 mA) R300 / B300 3 3 1 A 0.2 A 0.2 A 0.1 A
number of NC contacts delayed switching number of NO contacts delayed switching number of CO contacts • for auxiliary contacts • delayed switching operating frequency with 3RT2 contactor maximum contact reliability of auxiliary contacts contact reliability of auxiliary contacts according to UL Main circuit number of poles for main current circuit ampacity of the output relay at AC-15 • at 250 V at 50/60 Hz • at 400 V at 50/60 Hz • at 24 V • at 110 V • at 125 V • at 230 V • at 250 V	0 2 0 5 000 1/h one incorrect switching operation of 100 million switching operations (17 V, 5 mA) R300 / B300 3 3 4 1 A 0.2 A 0.2 A 0.1 A 0.1 A
number of NC contacts delayed switching         number of NO contacts delayed switching         number of CO contacts         • for auxiliary contacts         • delayed switching         operating frequency with 3RT2 contactor maximum         contact reliability of auxiliary contacts         contact reliability of auxiliary contacts according to UL         Main circuit         number of poles for main current circuit         ampacity of the output relay at AC-15         • at 250 V at 50/60 Hz         • at 400 V at 50/60 Hz         • at 24 V         • at 110 V         • at 250 V	0 2 0 5 000 1/h one incorrect switching operation of 100 million switching operations (17 V, 5 mA) R300 / B300 3 3 3 4 1 A 0.2 A 0.2 A 0.2 A 0.1 A 0.1 A 5 mA
number of NC contacts delayed switching         number of NO contacts delayed switching         number of CO contacts         • for auxiliary contacts         • delayed switching         operating frequency with 3RT2 contactor maximum         contact reliability of auxiliary contacts         contact reliability of auxiliary contacts according to UL         Main circuit         number of poles for main current circuit         ampacity of the output relay at AC-15         • at 250 V at 50/60 Hz         • at 400 V at 50/60 Hz         • at 250 V         • at 250 V	0 2 0 5 000 1/h one incorrect switching operation of 100 million switching operations (17 V, 5 mA) R300 / B300 3 3 3 4 1 A 0.2 A 0.2 A 0.2 A 0.1 A 0.1 A 5 mA
number of NC contacts delayed switching         number of NO contacts delayed switching         number of CO contacts         • for auxiliary contacts         • delayed switching         operating frequency with 3RT2 contactor maximum         contact reliability of auxiliary contacts         contact reliability of auxiliary contacts according to UL         Main circuit         number of poles for main current circuit         ampacity of the output relay at AC-15         • at 250 V at 50/60 Hz         • at 400 V at 50/60 Hz         • at 24 V         • at 110 V         • at 250 V	0 2 0 5 000 1/h one incorrect switching operation of 100 million switching operations (17 V, 5 mA) R300 / B300 3 3 3 A 3 A 3 A 3 A 1 A 0.2 A 0.2 A 0.1 A 5 mA 6 A
number of NC contacts delayed switching         number of NO contacts delayed switching         number of CO contacts         • for auxiliary contacts         • delayed switching         operating frequency with 3RT2 contactor maximum         contact reliability of auxiliary contacts         contact reliability of auxiliary contacts according to UL         Main circuit         number of poles for main current circuit         ampacity of the output relay at AC-15         • at 250 V at 50/60 Hz         • at 400 V at 50/60 Hz         • at 24 V         • at 110 V         • at 250 V	0 2 0 5 000 1/h one incorrect switching operation of 100 million switching operations (17 V, 5 mA) R300 / B300 3 3 3 A 3 A 3 A 3 A 1 A 0.2 A 0.2 A 0.1 A 5 mA 6 A
number of NC contacts delayed switching         number of NO contacts delayed switching         number of CO contacts         • for auxiliary contacts         • delayed switching         operating frequency with 3RT2 contactor maximum         contact reliability of auxiliary contacts         contact reliability of auxiliary contacts according to UL         Main circuit         number of poles for main current circuit         ampacity of the output relay at AC-15         • at 250 V at 50/60 Hz         • at 400 V at 50/60 Hz         • at 24 V         • at 110 V         • at 230 V         • at 250 V         operational current at 17 V minimum         continuous current of the DIAZED fuse link of the output relay         Electromagnetic compatibility         EMC emitted interference	0 2 0 5 000 1/h one incorrect switching operation of 100 million switching operations (17 V, 5 mA) R300 / B300 3 3 3 3 4 4 4 0.2 A 0.2 A 0.1 A 0.1 A 5 mA 6 A class A

	10 V/m
electrostatic discharge according to IEC 61000-4-3	6 kV contact discharge / 8 kV air discharge
Galvanic isolation	o kv contact discharge / o kv an discharge
design of the electrical isolation	galvanic isolation
galvanic isolation	gaivante isolation
between input and output	Yes
between the outputs	Yes
<ul> <li>between the voltage supply and other circuits</li> </ul>	Yes
Connections/ Terminals	
product component removable terminal for main circuit	Yes
product component removable terminal for auxiliary and	Yes
control circuit	
type of electrical connection	spring-loaded terminals
type of connectable conductor cross-sections	
• solid	0.5 4 mm²
<ul> <li>finely stranded with core end processing</li> </ul>	0.5 2.5 mm <sup>2</sup>
<ul> <li>finely stranded without core end processing</li> </ul>	0.5 4 mm²
<ul> <li>for AWG cables solid</li> </ul>	20 12
<ul> <li>for AWG cables stranded</li> </ul>	20 12
connectable conductor cross-section	
• solid	0.5 4 mm²
<ul> <li>finely stranded with core end processing</li> </ul>	0.5 2.5 mm <sup>2</sup>
<ul> <li>finely stranded without core end processing</li> </ul>	0.25 1.5 mm <sup>2</sup>
AWG number as coded connectable conductor cross section	
• solid	24 12
stranded	20 12
stripped length	10 mm
Installation/ mounting/ dimensions	
mounting position	any
fastening method	screw and snap-on mounting onto 35 mm DIN rail
height	100 mm
width	22.5 mm
depth	90 mm
<ul> <li>required spacing</li> <li>with side-by-side mounting</li> </ul>	
<ul> <li>with side-by-side mounting</li> <li>forwards</li> </ul>	0 mm
— backwards	0 mm
— upwards	0 mm
— upwalus	0 mm
- downwards	0 mm
— downwards	0 mm
— at the side	
<ul><li>— at the side</li><li> for grounded parts</li></ul>	0 mm 0 mm
<ul> <li>— at the side</li> <li>for grounded parts</li> <li>— forwards</li> </ul>	0 mm 0 mm 0 mm
<ul> <li>at the side</li> <li>for grounded parts</li> <li>forwards</li> <li>backwards</li> </ul>	0 mm 0 mm 0 mm
<ul> <li>at the side</li> <li>for grounded parts</li> <li>forwards</li> <li>backwards</li> <li>upwards</li> </ul>	0 mm 0 mm 0 mm 0 mm 0 mm
<ul> <li>at the side</li> <li>for grounded parts</li> <li>forwards</li> <li>backwards</li> <li>upwards</li> <li>at the side</li> </ul>	0 mm 0 mm 0 mm 0 mm 0 mm 0 mm
<ul> <li>at the side</li> <li>for grounded parts</li> <li>forwards</li> <li>backwards</li> <li>upwards</li> <li>at the side</li> <li>downwards</li> </ul>	0 mm 0 mm 0 mm 0 mm 0 mm
<ul> <li>at the side</li> <li>for grounded parts</li> <li>forwards</li> <li>backwards</li> <li>upwards</li> <li>at the side</li> <li>downwards</li> <li>for live parts</li> </ul>	0 mm 0 mm 0 mm 0 mm 0 mm 0 mm 0 mm
<ul> <li>at the side</li> <li>for grounded parts</li> <li>forwards</li> <li>backwards</li> <li>upwards</li> <li>at the side</li> <li>downwards</li> </ul>	0 mm 0 mm 0 mm 0 mm 0 mm 0 mm
<ul> <li>at the side</li> <li>for grounded parts</li> <li>forwards</li> <li>backwards</li> <li>upwards</li> <li>at the side</li> <li>downwards</li> <li>for live parts</li> <li>forwards</li> <li>backwards</li> </ul>	0 mm 0 mm 0 mm 0 mm 0 mm 0 mm 0 mm 0 mm
<ul> <li>at the side</li> <li>for grounded parts</li> <li>forwards</li> <li>backwards</li> <li>upwards</li> <li>at the side</li> <li>downwards</li> <li>for live parts</li> <li>forwards</li> </ul>	0 mm 0 mm 0 mm 0 mm 0 mm 0 mm 0 mm
<ul> <li>at the side</li> <li>for grounded parts</li> <li>forwards</li> <li>backwards</li> <li>upwards</li> <li>at the side</li> <li>downwards</li> <li>for live parts</li> <li>forwards</li> <li>backwards</li> <li>upwards</li> <li>upwards</li> </ul>	0 mm 0 mm 0 mm 0 mm 0 mm 0 mm 0 mm 0 mm 0 mm 0 mm
<ul> <li>at the side</li> <li>for grounded parts</li> <li>forwards</li> <li>backwards</li> <li>upwards</li> <li>at the side</li> <li>downwards</li> <li>for live parts</li> <li>forwards</li> <li>backwards</li> <li>backwards</li> <li>upwards</li> <li>downwards</li> </ul>	0 mm 0 mm
<ul> <li>at the side</li> <li>for grounded parts</li> <li>forwards</li> <li>backwards</li> <li>upwards</li> <li>at the side</li> <li>downwards</li> <li>for live parts</li> <li>for wards</li> <li>backwards</li> <li>backwards</li> <li>upwards</li> <li>at the side</li> <li>at the side</li> </ul>	0 mm 0 mm
<ul> <li>at the side</li> <li>for grounded parts</li> <li>forwards</li> <li>backwards</li> <li>upwards</li> <li>at the side</li> <li>downwards</li> <li>for live parts</li> <li>for live parts</li> <li>forwards</li> <li>backwards</li> <li>upwards</li> <li>at the side</li> <li>downwards</li> <li>at the side</li> </ul>	0 mm 0 mm
<ul> <li>at the side</li> <li>for grounded parts</li> <li>forwards</li> <li>backwards</li> <li>upwards</li> <li>at the side</li> <li>downwards</li> <li>for live parts</li> <li>for wards</li> <li>backwards</li> <li>backwards</li> <li>upwards</li> <li>at the side</li> </ul> Ambient conditions installation altitude at height above sea level maximum	0 mm 0 mm
<ul> <li>at the side</li> <li>for grounded parts</li> <li>forwards</li> <li>backwards</li> <li>upwards</li> <li>at the side</li> <li>downwards</li> <li>for live parts</li> <li>for live parts</li> <li>forwards</li> <li>backwards</li> <li>backwards</li> <li>at the side</li> <li>downwards</li> <li>at the side</li> </ul>	0 mm 0 mm
<ul> <li>at the side</li> <li>for grounded parts</li> <li>forwards</li> <li>backwards</li> <li>upwards</li> <li>at the side</li> <li>downwards</li> <li>for live parts</li> <li>for wards</li> <li>backwards</li> <li>backwards</li> <li>upwards</li> <li>at the side</li> <li>downwards</li> <li>at the side</li> </ul> Ambient conditions installation altitude at height above sea level maximum ambient temperature <ul> <li>during operation</li> <li>during storage</li> </ul>	0 mm 0 mm
<ul> <li>at the side</li> <li>for grounded parts</li> <li>forwards</li> <li>backwards</li> <li>upwards</li> <li>at the side</li> <li>downwards</li> <li>for live parts</li> <li>for live parts</li> <li>forwards</li> <li>backwards</li> <li>backwards</li> <li>at the side</li> <li>downwards</li> <li>at the side</li> </ul>	0 mm 0 mm



#### **General Product Approval**

Confirmation





CE





Type Test Certificates/Test Report

**Test Certificates** 

other

**Confirmation** 

Further information

Siemens has decided to exit the Russian market (see here).

https://press.siemens.com/global/en/pressrelease/siemens-wind-down-russian-business

Siemens is working on the renewal of the current EAC certificates.

Please contact your local Siemens office on the status of validity of the EAC certification if you intend to import or offer to supply these products to an EAC relevant market (other than the sanctioned EAEU member states Russia or Belarus).

#### Information on the packaging

https://support.industry.siemens.com/cs/ww/en/view/109813875

Information- and Downloadcenter (Catalogs, Brochures,...)

https://www.siemens.com/ic10

Industry Mall (Online ordering system)

https://mall.industry.siemens.com/mall/en/en/Catalog/product?mlfb=3UG5511-2BR20

Cax online generator

http://support.automation.siemens.com/WW/CAXorder/default.aspx?lang=en&mlfb=3UG5511-2BR20


Service&Support (Manuals, Certificates, Characteristics, FAQs,...)


https://support.industry.siemens.com/cs/ww/en/ps/3UG5511-2BR20


Image database (product images, 2D dimension drawings, 3D models, device circuit diagrams, EPLAN macros, ...) http://www.automation.siemens.com/bilddb/cax\_de.aspx?mlfb=3UG5511-2BR20&lang=en


Characteristic: Derating

https://support.industry.siemens.com/cs/ww/en/ps/3UG5511-2BR20/manual





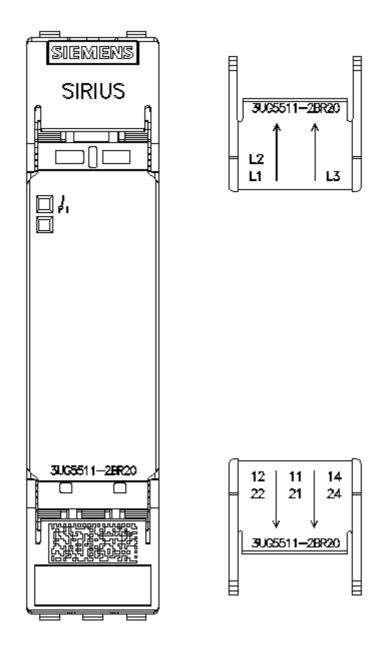

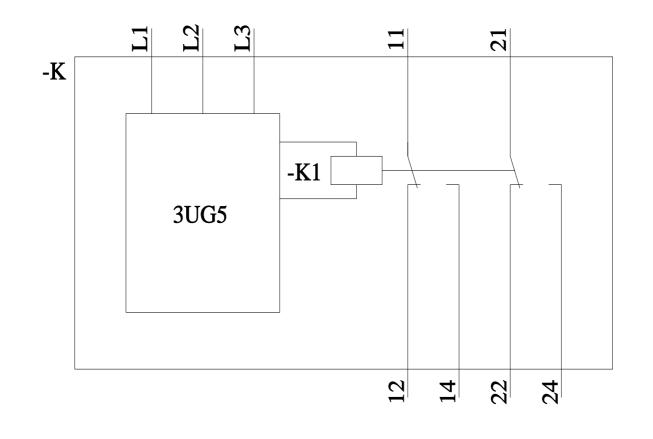

last modified:

12/12/2023 🖸