SIEMENS

Data sheet

3UG5512-2AR20



monitoring relay phase failure, phase sequence and asymmetry monitoring 3x 160-690 V AC, 15-70 Hz 1 changeover contact spring-loaded terminal


product brand name	SIRIUS			
product designation	Line monitoring relay			
design of the product	monitoring of phase sequence, phase failure and asymmetry			
product type designation	3UG5			
General technical data				
product function	line monitoring			
display version LED	Yes			
design of the display	LED			
power loss [W] maximum	1.8 W			
power loss [V·A] maximum	5.1 VA			
insulation voltage for overvoltage category III according to IEC 60664				
 with degree of pollution 2 rated value 	690 V			
 with degree of pollution 3 rated value 	690 V			
degree of pollution	3			
type of voltage				
for monitoring	AC			
 of the operating voltage for actuation 	AC/DC			
 of the control supply voltage 	AC			
surge voltage resistance rated value	6 kV			
protection class IP	IP20			
shock resistance according to IEC 60068-2-27	sinusoidal half-wave 15g / 11 ms			
switching behavior	monostable			
mechanical service life (operating cycles) typical	10 000 000			
electrical endurance (operating cycles) at AC-15 at 230 V typical	100 000			
thermal current of the switching element with contacts maximum	5 A			
reference code according to IEC 81346-2	К			
Substance Prohibitance (Date)	06/01/2023			
SVHC substance name	Blei - 7439-92-1 Bleimonoxid (Bleioxid) - 1317-36-8			
Product Function				
product function				
 undervoltage detection 	No			
 overvoltage detection 	No			
 phase sequence recognition 	Yes			
phase failure detection	Yes; available but limited, detection is problematic with high levels of regenerative power recovery			
 asymmetry detection 	Yes; not adjustable, indirectly by monitoring the voltage limit values			
 overvoltage detection 3 phase 	No			
 undervoltage detection 3 phases 	No			


• voltage window recognition 2 phase	No
voltage window recognition 3 phase	No
adjustable open/closed-circuit current principle	No
auto-RESET	Yes
suitability for use safety-related circuits	No
Control circuit/ Control	
control supply voltage at AC	00 000 1/
at 50 Hz rated value	90 690 V
at 60 Hz rated value	90 690 V
operating range factor control supply voltage rated value at AC at 50 Hz	
initial value	0.85
full-scale value	1.1
operating range factor control supply voltage rated value at AC at 60 Hz	
initial value	0.85
• full-scale value	1.1
Supply voltage	
supply voltage frequency rated value	70 15 Hz
Measuring circuit	
measurable voltage at AC	90 690 V
buffering time in the event of power failure minimum	20 ms
response time maximum	500 ms
relative temperature-related measurement deviation	1 %
Precision	
relative metering precision	5 %
temperature drift per °C	0.003 %/°C
Short-circuit protection	
design of the fuse link	
 for short-circuit protection of the NO contacts of the relay outputs required 	gL/gG: 6 A or MCB type C: 1 A
 for short circuit protection of the NC contacts of the relay 	gL/gG: 6 A or MCB type C: 1 A
outputs required	
outputs required Communication/ Protocol	
	No
Communication/ Protocol protocol is supported IO-Link protocol type of voltage supply via input/output link master	No
Communication/ Protocol protocol is supported IO-Link protocol	
Communication/ Protocol protocol is supported IO-Link protocol type of voltage supply via input/output link master	
Communication/ Protocol protocol is supported IO-Link protocol type of voltage supply via input/output link master Auxiliary circuit	No
Communication/ Protocol protocol is supported IO-Link protocol type of voltage supply via input/output link master Auxiliary circuit material of switching contacts	No AgSnO2
Communication/ Protocol protocol is supported IO-Link protocol type of voltage supply via input/output link master Auxiliary circuit material of switching contacts number of NC contacts delayed switching number of NO contacts delayed switching number of CO contacts	No AgSnO2 0 0
Communication/ Protocol protocol is supported IO-Link protocol type of voltage supply via input/output link master Auxiliary circuit material of switching contacts number of NC contacts delayed switching number of NO contacts delayed switching number of CO contacts • for auxiliary contacts	No AgSnO2 0 0 1
Communication/ Protocol protocol is supported IO-Link protocol type of voltage supply via input/output link master Auxiliary circuit material of switching contacts number of NC contacts delayed switching number of NO contacts delayed switching number of CO contacts • for auxiliary contacts • delayed switching	No AgSnO2 0 0 1 0
Communication/ Protocol protocol is supported IO-Link protocol type of voltage supply via input/output link master Auxiliary circuit material of switching contacts number of NC contacts delayed switching number of NO contacts delayed switching number of CO contacts • for auxiliary contacts • delayed switching operating frequency with 3RT2 contactor maximum	No Ag\$nO2 0 0 1 1 0 5 000 1/h
Communication/ Protocol protocol is supported IO-Link protocol type of voltage supply via input/output link master Auxiliary circuit material of switching contacts number of NC contacts delayed switching number of NO contacts delayed switching number of CO contacts • for auxiliary contacts • delayed switching	No AgSnO2 0 0 1 0
Communication/ Protocol protocol is supported IO-Link protocol type of voltage supply via input/output link master Auxiliary circuit material of switching contacts number of NC contacts delayed switching number of NO contacts delayed switching number of CO contacts • for auxiliary contacts • delayed switching operating frequency with 3RT2 contactor maximum contact reliability of auxiliary contacts contact rating of auxiliary contacts according to UL	No AgSnO2 0 0 1 1 0 5 000 1/h one incorrect switching operation of 100 million switching operations (17 V, 5
Communication/ Protocol protocol is supported IO-Link protocol type of voltage supply via input/output link master Auxiliary circuit material of switching contacts number of NC contacts delayed switching number of NO contacts delayed switching number of CO contacts • for auxiliary contacts • delayed switching operating frequency with 3RT2 contactor maximum contact reliability of auxiliary contacts contact rating of auxiliary contacts according to UL Main circuit	No AgSnO2 0 0 1 1 0 5 000 1/h one incorrect switching operation of 100 million switching operations (17 V, 5 mA) R300 / B300
Communication/ Protocol protocol is supported IO-Link protocol type of voltage supply via input/output link master Auxiliary circuit material of switching contacts number of NC contacts delayed switching number of NO contacts delayed switching number of CO contacts • for auxiliary contacts • delayed switching operating frequency with 3RT2 contactor maximum contact reliability of auxiliary contacts contact rating of auxiliary contacts according to UL Main circuit number of poles for main current circuit	No AgSnO2 0 0 1 0 5 000 1/h one incorrect switching operation of 100 million switching operations (17 V, 5 mA)
Communication/ Protocol protocol is supported IO-Link protocol type of voltage supply via input/output link master Auxiliary circuit material of switching contacts number of NC contacts delayed switching number of NO contacts delayed switching number of CO contacts • for auxiliary contacts • delayed switching operating frequency with 3RT2 contactor maximum contact reliability of auxiliary contacts contact rating of auxiliary contacts according to UL Main circuit number of poles for main current circuit ampacity of the output relay at AC-15	No AgSnO2 0 0 1 0 5 000 1/h one incorrect switching operation of 100 million switching operations (17 V, 5 mA) R300 / B300 3
Communication/ Protocol protocol is supported IO-Link protocol type of voltage supply via input/output link master Auxiliary circuit material of switching contacts number of NC contacts delayed switching number of NO contacts delayed switching number of CO contacts • for auxiliary contacts • delayed switching operating frequency with 3RT2 contactor maximum contact reliability of auxiliary contacts contact rating of auxiliary contacts according to UL Main circuit number of poles for main current circuit ampacity of the output relay at AC-15 • at 250 V at 50/60 Hz	No AgSnO2 0 0 1 0 5 000 1/h one incorrect switching operation of 100 million switching operations (17 V, 5 mA) R300 / B300 3 3
Communication/ Protocol protocol is supported IO-Link protocol type of voltage supply via input/output link master Auxiliary circuit material of switching contacts number of NC contacts delayed switching number of NO contacts delayed switching number of CO contacts • for auxiliary contacts • delayed switching operating frequency with 3RT2 contactor maximum contact reliability of auxiliary contacts contact rating of auxiliary contacts according to UL Main circuit number of poles for main current circuit ampacity of the output relay at AC-15 • at 250 V at 50/60 Hz • at 400 V at 50/60 Hz	No AgSnO2 0 0 1 0 5 000 1/h one incorrect switching operation of 100 million switching operations (17 V, 5 mA) R300 / B300 3
Communication/ Protocol protocol is supported IO-Link protocol type of voltage supply via input/output link master Auxiliary circuit material of switching contacts number of NC contacts delayed switching number of NO contacts delayed switching number of CO contacts • for auxiliary contacts • delayed switching operating frequency with 3RT2 contactor maximum contact reliability of auxiliary contacts contact reliability of auxiliary contacts according to UL Main circuit number of poles for main current circuit ampacity of the output relay at AC-15 • at 250 V at 50/60 Hz • at 400 V at 50/60 Hz ampacity of the output relay at DC-13	No AgSnO2 0 0 1 1 0 5 000 1/h one incorrect switching operation of 100 million switching operations (17 V, 5 mA) R300 / B300 3 3 A 3 A 3 A
Communication/ Protocol protocol is supported IO-Link protocol type of voltage supply via input/output link master Auxiliary circuit material of switching contacts number of NC contacts delayed switching number of NO contacts delayed switching number of CO contacts • for auxiliary contacts • delayed switching operating frequency with 3RT2 contactor maximum contact reliability of auxiliary contacts contact rating of auxiliary contacts according to UL Main circuit number of poles for main current circuit ampacity of the output relay at AC-15 • at 400 V at 50/60 Hz • at 24 V	No AgSnO2 0 0 1 1 0 5 000 1/h one incorrect switching operation of 100 million switching operations (17 V, 5 mA) R300 / B300 3 3 A 3 A 3 A 3 A 1 A
Communication/ Protocol protocol is supported IO-Link protocol type of voltage supply via input/output link master Auxiliary circuit material of switching contacts number of NC contacts delayed switching number of NO contacts delayed switching number of CO contacts • for auxiliary contacts • delayed switching operating frequency with 3RT2 contactor maximum contact reliability of auxiliary contacts contact reliability of auxiliary contacts contact rating of auxiliary contacts according to UL Main circuit number of poles for main current circuit ampacity of the output relay at AC-15 • at 250 V at 50/60 Hz • at 400 V at 50/60 Hz • at 24 V • at 110 V	No AgSnO2 0 0 1 0 5 000 1/h one incorrect switching operation of 100 million switching operations (17 V, 5 mA) R300 / B300 3 3 A 3 A 3 A 1 A 0.2 A
Communication/ Protocol protocol is supported IO-Link protocol type of voltage supply via input/output link master Auxiliary circuit material of switching contacts number of NC contacts delayed switching number of NO contacts delayed switching number of CO contacts • for auxiliary contacts • delayed switching operating frequency with 3RT2 contactor maximum contact reliability of auxiliary contacts contact reliability of auxiliary contacts contact rating of auxiliary contacts according to UL Main circuit number of poles for main current circuit ampacity of the output relay at AC-15 • at 250 V at 50/60 Hz • at 400 V at 50/60 Hz • at 24 V • at 110 V • at 125 V	No AgSnO2 0 0 1 0 5 000 1/h one incorrect switching operation of 100 million switching operations (17 V, 5 mA) R300 / B300 3 3 A 3 A 3 A 1 A 0.2 A
Communication/ Protocol protocol is supported IO-Link protocol type of voltage supply via input/output link master Auxiliary circuit material of switching contacts number of NC contacts delayed switching number of NO contacts delayed switching number of CO contacts • for auxiliary contacts • delayed switching operating frequency with 3RT2 contactor maximum contact reliability of auxiliary contacts contact reliability of auxiliary contacts according to UL Main circuit number of poles for main current circuit ampacity of the output relay at AC-15 • at 250 V at 50/60 Hz • at 400 V at 50/60 Hz • at 24 V • at 110 V • at 230 V	No AgSnO2 0 0 1 0 5 000 1/h one incorrect switching operation of 100 million switching operations (17 V, 5 mA) R300 / B300 3 3 A 3 A 3 A 0.2 A 0.2 A 0.1 A
Communication/ Protocol protocol is supported IO-Link protocol type of voltage supply via input/output link master Auxiliary circuit material of switching contacts number of NC contacts delayed switching number of NO contacts delayed switching number of CO contacts • for auxiliary contacts • delayed switching operating frequency with 3RT2 contactor maximum contact reliability of auxiliary contacts contact reliability of auxiliary contacts according to UL Main circuit number of poles for main current circuit ampacity of the output relay at AC-15 • at 250 V at 50/60 Hz • at 24 V • at 110 V • at 230 V • at 250 V	No AgSnO2 0 0 1 0 5 000 1/h one incorrect switching operation of 100 million switching operations (17 V, 5 mA) R300 / B300 3 1 A 0.2 A 0.2 A 0.1 A
Communication/ Protocol protocol is supported IO-Link protocol type of voltage supply via input/output link master Auxiliary circuit material of switching contacts number of NC contacts delayed switching number of NO contacts delayed switching number of CO contacts • for auxiliary contacts • delayed switching operating frequency with 3RT2 contactor maximum contact reliability of auxiliary contacts contact reliability of auxiliary contacts according to UL Main circuit number of poles for main current circuit ampacity of the output relay at AC-15 • at 250 V at 50/60 Hz • at 24 V • at 110 V • at 230 V • at 250 V • at 250 V	No AgSnO2 0 0 1 0 5 000 1/h one incorrect switching operation of 100 million switching operations (17 V, 5 mA) R300 / B300 3 3 A 3 A 3 A 3 A 3 A 1 A 0.2 A 0.1 A 5 mA
Communication/ Protocol protocol is supported IO-Link protocol type of voltage supply via input/output link master Auxiliary circuit material of switching contacts number of NC contacts delayed switching number of NO contacts delayed switching number of CO contacts • for auxiliary contacts • delayed switching operating frequency with 3RT2 contactor maximum contact reliability of auxiliary contacts contact reliability of auxiliary contacts contact rating of auxiliary contacts according to UL Main circuit number of poles for main current circuit ampacity of the output relay at AC-15 • at 250 V at 50/60 Hz • at 24 V • at 110 V • at 230 V • at 250 V operational current at 17 V minimum continuous current of the DIAZED fuse link of the output relay	No AgSnO2 0 0 1 0 5 000 1/h one incorrect switching operation of 100 million switching operations (17 V, 5 mA) R300 / B300 3 1 A 0.2 A 0.2 A 0.1 A
Communication/ Protocol protocol is supported IO-Link protocol type of voltage supply via input/output link master Auxiliary circuit material of switching contacts number of NC contacts delayed switching number of NO contacts delayed switching number of CO contacts • for auxiliary contacts • delayed switching operating frequency with 3RT2 contactor maximum contact reliability of auxiliary contacts contact reliability of auxiliary contacts contact rating of auxiliary contacts according to UL Main circuit number of poles for main current circuit ampacity of the output relay at AC-15 • at 250 V at 50/60 Hz • at 24 V • at 110 V • at 230 V • at 250 V operational current at 17 V minimum continuous current of the DIAZED fuse link of the output	No AgSnO2 0 0 1 0 5 000 1/h one incorrect switching operation of 100 million switching operations (17 V, 5 mA) R300 / B300 3 3 A 3 A 3 A 3 A 3 A 1 A 0.2 A 0.1 A 5 mA


conducted interference				
 due to burst according to IEC 61000-4-4 	2 kV (power ports), 2 kV (signal ports)			
 due to conductor-earth surge according to IEC 61000-4-5 	2 kV			
 due to conductor-conductor surge according to IEC 61000-4-5 	1 kV			
field-based interference according to IEC 61000-4-3	10 V/m			
electrostatic discharge according to IEC 61000-4-2	6 kV contact discharge / 8 kV air discharge			
Galvanic isolation				
design of the electrical isolation	galvanic isolation			
galvanic isolation				
 between input and output 	Yes			
 between the voltage supply and other circuits 	Yes			
Connections/ Terminals				
product component removable terminal for main circuit	Yes			
product component removable terminal for auxiliary and control circuit	Yes			
type of electrical connection	spring-loaded terminals			
type of connectable conductor cross-sections				
• solid	0.5 4 mm²			
 finely stranded with core end processing 	0.5 2.5 mm²			
 finely stranded without core end processing 	0.5 4 mm²			
 for AWG cables solid 	20 12			
 for AWG cables stranded 	20 12			
connectable conductor cross-section				
• solid	0.5 4 mm²			
 finely stranded with core end processing 	0.5 2.5 mm ²			
 finely stranded without core end processing 	0.25 1.5 mm ²			
AWG number as coded connectable conductor cross section				
• solid	24 12			
stranded	20 12			
stripped length	10 mm			
Installation/ mounting/ dimensions				
mounting position	any			
fastening method	screw and snap-on mounting onto 35 mm DIN rail			
height	100 mm			
width	22.5 mm			
depth	90 mm			
required spacing				
with side-by-side mounting	0 mm			
— forwards — backwards	0 mm			
— upwards				
— upwards — downwards	0 mm 0 mm			
— at the side				
	() mm			
	0 mm			
• for grounded parts				
 for grounded parts — forwards 	0 mm			
 for grounded parts forwards backwards 	0 mm 0 mm			
 for grounded parts forwards backwards upwards 	0 mm 0 mm 0 mm			
 for grounded parts forwards backwards upwards at the side 	0 mm 0 mm 0 mm 0 mm			
 for grounded parts forwards backwards upwards at the side downwards 	0 mm 0 mm 0 mm			
 for grounded parts forwards backwards upwards at the side 	0 mm 0 mm 0 mm 0 mm			
 for grounded parts forwards backwards upwards at the side downwards for live parts 	0 mm 0 mm 0 mm 0 mm 0 mm			
 for grounded parts forwards backwards upwards at the side downwards for live parts forwards backwards 	0 mm 0 mm 0 mm 0 mm 0 mm			
 for grounded parts forwards backwards upwards at the side downwards for live parts forwards backwards backwards upwards 	0 mm 0 mm 0 mm 0 mm 0 mm 0 mm 0 mm 0 mm			
 for grounded parts forwards backwards upwards at the side downwards for live parts forwards backwards 	0 mm 0 mm 0 mm 0 mm 0 mm 0 mm			
 for grounded parts forwards backwards upwards at the side downwards for live parts forwards backwards backwards upwards downwards 	0 mm 0 mm 0 mm 0 mm 0 mm 0 mm 0 mm 0 mm 0 mm 0 mm			
 for grounded parts forwards backwards upwards at the side downwards for live parts forwards backwards backwards upwards downwards at the side 	0 mm 0 mm 0 mm 0 mm 0 mm 0 mm 0 mm 0 mm 0 mm 0 mm			
 for grounded parts forwards backwards upwards at the side downwards for live parts forwards backwards backwards upwards at the side Annotation of the side 	0 mm 0 mm			
 for grounded parts forwards backwards upwards at the side downwards for live parts forwards forwards backwards backwards upwards downwards at the side Ambient conditions installation altitude at height above sea level maximum 	0 mm 0 mm			


 during storage 		. +85 °C				
during transport		-40 +85 °C				
relative humidity during operation	70 %					
Approvals Certificates						
General Product Approval				Test Certificates		
Confirmation UK	CE EG-Konf.	(U) II	EHC	Type Test Certific- ates/Test Report		
other						
Confirmation Further information Siemens has decided to exit the Russian market (see here).					
https://press.siemens.com/global/en/pressrelease/siemens-wind-down-russian-business						
Siemens is working on the renewal of the current EAC certificates. Please contact your local Siemens office on the status of validity of the EAC certification if you intend to import or offer to supply these products to an EAC relevant market (other than the sanctioned EAEU member states Russia or Belarus). Information on the packaging https://support.industry.siemens.com/cs/ww/en/view/109813875						
Information- and Downloadcenter (Catalogs, Brochures,) https://www.siemens.com/ic10						
Industry Mall (Online ordering system) https://mall.industry.siemens.com/mall/en/en/Catalog/product?mlfb=3UG5512-2AR20						
Cax online generator http://support.automation.siemens.com/WW/CAXorde Service&Support (Manuals, Certificates, Characte https://support.industry.siemens.com/cs/ww/en/ps/3L	er/default.aspx?lang= eristics, FAQs,)		0			
Image database (product images, 2D dimension drawings, 3D models, device circuit diagrams, EPLAN macros,) http://www.automation.siemens.com/bilddb/cax_de.aspx?mlfb=3UG5512-2AR20⟨=en Characteristic: Derating						

Characteristic: Derating https://support.industry.siemens.com/cs/ww/en/ps/3UG5512-2AR20/manual





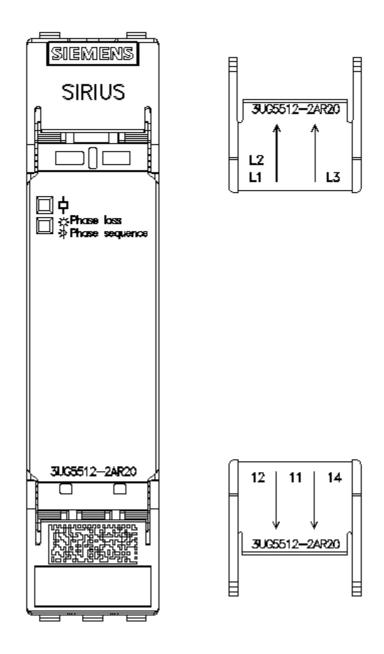

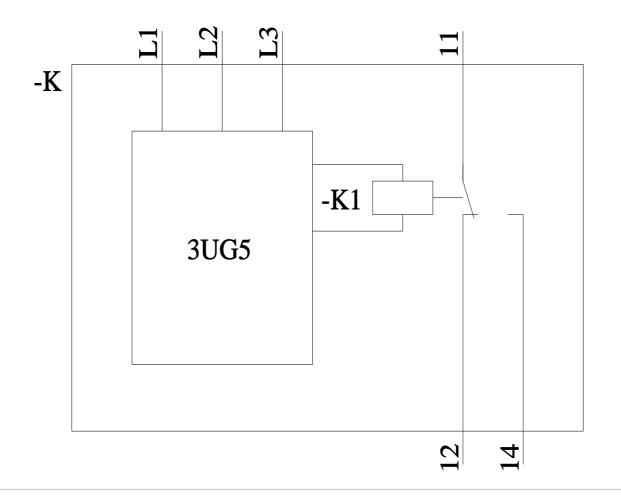

last modified:

12/13/2023 🖸