



Mosaic™
Danish socket outlet

Cat. no(s).: 0 775 08/09

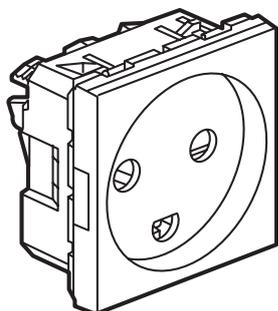

0 775 08

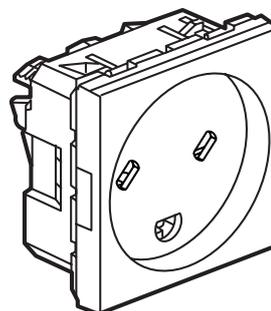

0 775 09

1. USE


Danish socket outlet.

2. RANGE

Designation	Cat. No.
2 P+E socket	0 778 08
2 P+E socket	0 778 09

3. POSITIONING


The mechanisms can be mounted on fush-mounted Batibox boxes.

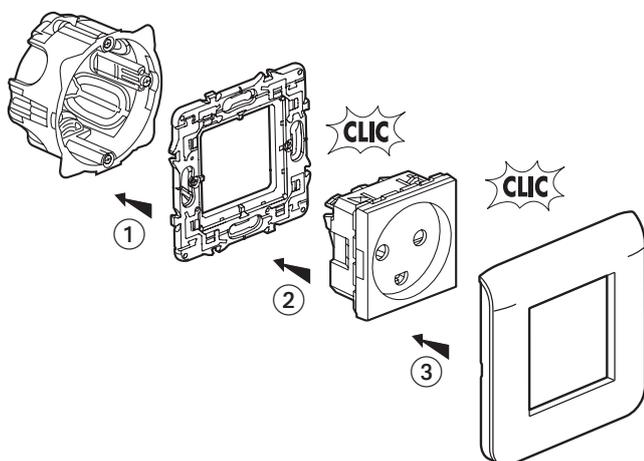

- 1 - Screwed the support frame onto the flush box.
- 2 - Clip the rear of the mechanism onto the support frame.
- 3 - Clip the cover plate onto the mechanism.


3. POSITIONING (continued)

The mechanisms can be mounted on DLP trunking with support frame/ plates Cat. No(s): 0 109 92/94/96/98 and isolating box Cat. No 0 109 27.

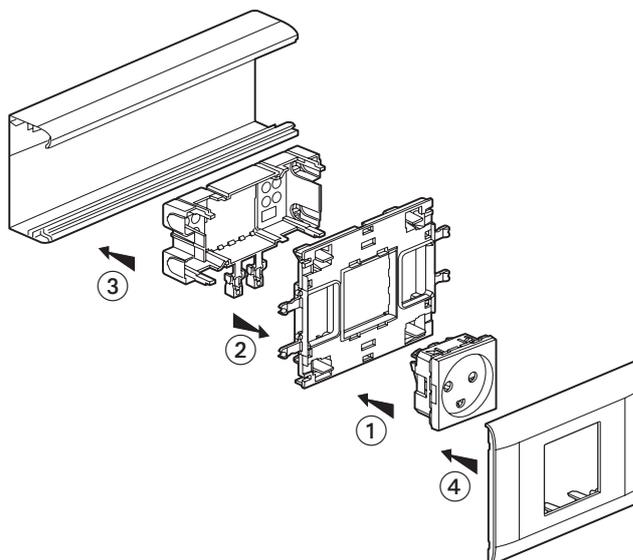

- 1 - Clip the rear of mechanism onto the support frame
- 2 - Assembling the insulating housing to the support by the rear
- 3 - Clip the block on the DLP trunking
- 4 - Clip the cover plate onto the mechanism


4. OVERALL DIMENSIONS

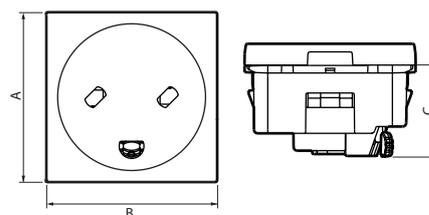

A	B	C
45	45	22.5

5. CONNECTION

Automatic terminals
Capacity: 2 x 2.5 mm²
Stripping length: 13 mm



6. TECHNICAL CHARACTERISTICS

■ 6.1 Mechanical characteristics

Impact tests: IK 04
Protection against solid bodies and liquids: IP 41

■ 6.2 Material characteristics

Cover plate: polycarbonate (RAL 9003)
Base: polycarbonate

■ 6.3 Electrical characteristics

Voltage: 250 VAC
Current: 13 A
Self extinguishing: 650° C / 30 s.

■ 6.4 Climatic characteristics

Storage temperature: - 10° C to + 70° C
Operating temperature: - 5° C to + 40° C

7. CLEANING

Surface cleaning with a cloth.
Do not use: acetone, tar remover, trichloroethylene.

■ 7.1 Resistance to cleaning agents

- Hexane (EN 60669-1)
- Methylated spirits
- Soapy water
- Diluted ammonia
- Diluted pure bleach 10%
- Glass cleaning substance
- Pre-impregnated wipes.

■ 7.2 Resistance to hospital-type cleaning agents

Resistance to the following agents:
- Anios
- Surfanios
- Bactylsine
- Diluted hydrogen peroxide (35%)

Caution: A preliminary test should be carried out if other specific cleaning products are to be used.

8. CONFORMITY AND APPROVALS

Approval in process: DEMKO