

Tamper

- 1) Connect tamper switch to appropriate inputs of control and indicating equipment (CIE).

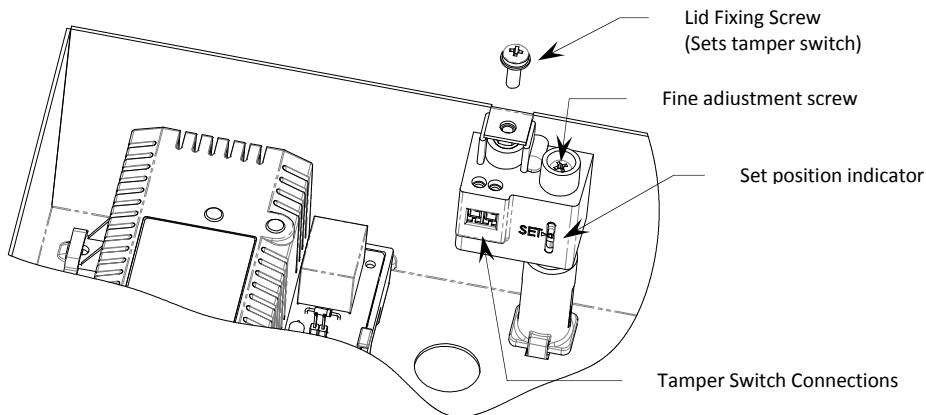


Fig 1 Position of tamper assembly on 'hinged lid' style enclosures

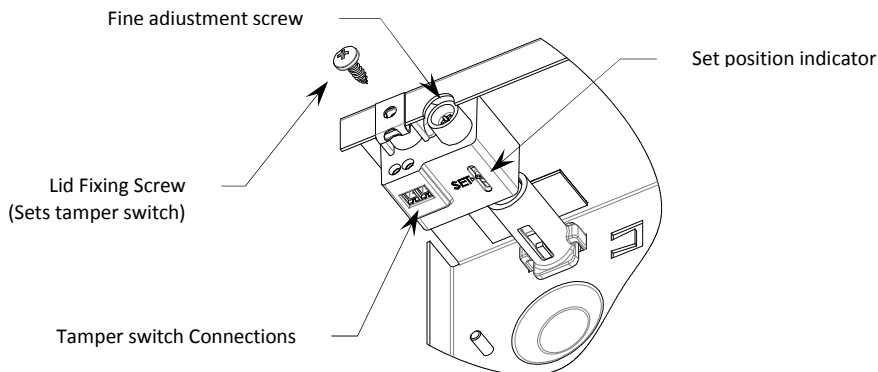


Fig 2 Position of tamper assembly on 'clam shell' style enclosures

- 2) Close the lid and fasten with screw supplied. Alternatively for 'clam shell' style fit the cover in place, the correct orientation is with the cover retaining feature engaging over the bottom lip of the base, fasten with screws supplied.
- 3) With the unit mounted on the wall check that the rear tamper is not in a position that will affect its operation, for example over a mortar course, recess or raised area on the wall.
Check that the tamper switch is:
CLOSED when the lid/cover is closed and the retaining screws are fitted,
OPEN when the retaining screws are removed and the lid/cover is open.
Use fine adjustment screw if necessary to align indicator with set point.
- 4) Close the lid/cover and fasten.
Re-check tamper circuit is closed at the control panel.