



SEPARATE ACTUATOR,  
RADIUS ACTUATOR RIGHT FOR POS. W. TUMBLER  
3SE5312../3SE5322.. AND ASI 3SF13... AND POS. WITH  
SEPARATE ACTUATOR 3SE51../3SE52.. AND ASI  
3SF11../3SF21..

General technical details:		
product designation		actuator
Mechanical operating cycles as operating time		
• typical		1,000,000
Resistance against vibration		0.35 mm / 5g
Resistance against shock		30g / 11 ms
Ambient temperature		
• during operating	°C	-25 ... +85
• during storage	°C	-40 ... +90
Design of the operating mechanism		radius actuator, right
Built in orientation		any
Item designation		
• according to DIN 40719 extendable after IEC 204-2 / according to IEC 750		E
• according to DIN EN 61346-2		T

Certificates/approvals:

## General Product Approval

## Functional Safety / Safety of Machinery

## Test Certificates



CQC



CSA

[ROSTEST](#)



VDE

[TÜV](#)

[Manufacturer](#)

other

[Manufacturer](#)

## Further information:

### Information- and Downloadcenter (Catalogs, Brochures,...)

<http://www.siemens.com/industrial-controls/catalogs>

### Industry Mall (Online ordering system)

<http://www.siemens.com/industrial-controls/mall>

### CAX-Online-Generator


<http://www.siemens.com/cax>

### Service&Support (Manuals, Certificates, Characteristics, FAQs,...)

<http://support.automation.siemens.com/WW/view/en/3SE5000-0AV06/all>

### Image database (product images, 2D dimension drawings, 3D models, device circuit diagrams, ...)

[http://www.automation.siemens.com/bilddb/cax\\_en.aspx?mlfb=3SE5000-0AV06](http://www.automation.siemens.com/bilddb/cax_en.aspx?mlfb=3SE5000-0AV06)

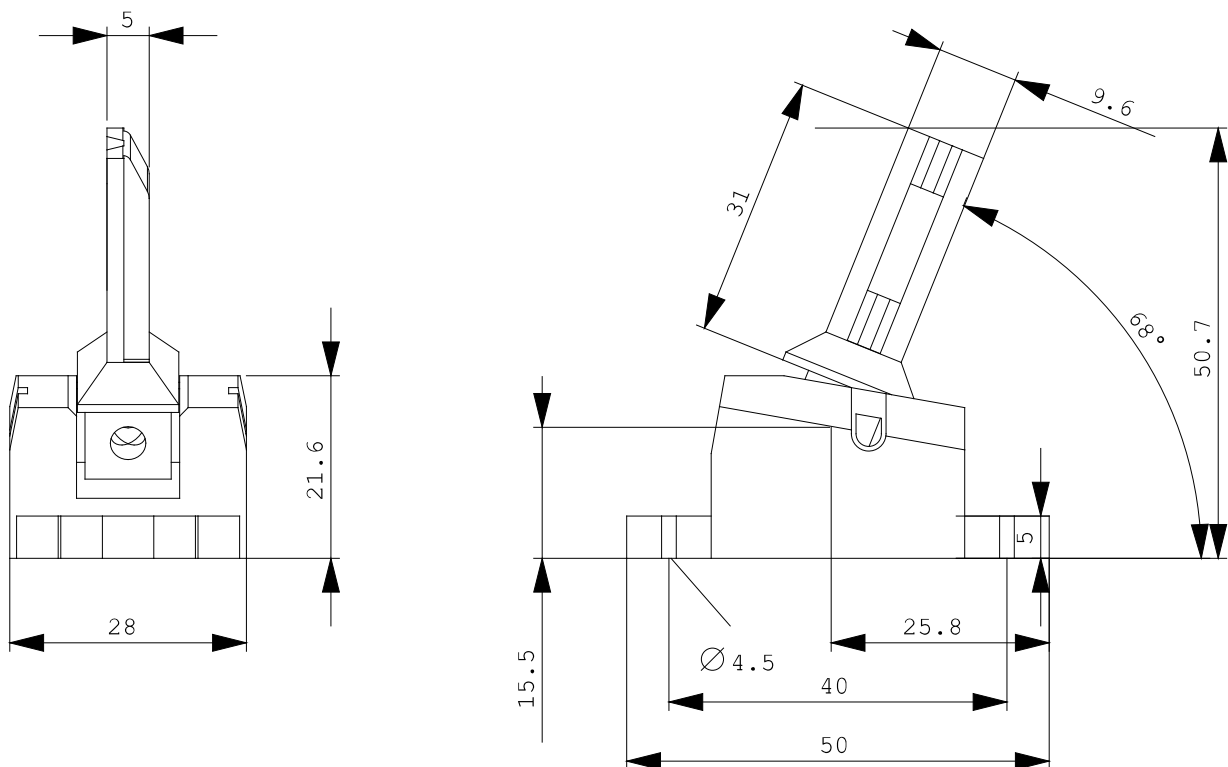

last change:

Nov 28, 2011